




RECLAIMED WATER USE/WARNING SIGN

NOTE: EACH DEVELOPMENT, SUBDIVISION, OR COMMERCIAL ESTABLISHMENT, REGARDLESS OF THE NUMBER OF BUILDINGS, SHALL INSTALL RECLAIMED WATER USE WARNING SIGNS AT THE ENTRANCES TO ANY PROPERTIES WHICH USE RECLAIMED WATER. THE SIGNS SHALL MEET THE REQUIREMENTS OF SJCUD DETAILS AND SPECIFICATIONS. THE SIGNS SHALL BE A REQUIREMENT WHETHER SHOWN ON PLANS OR NOT. DIRECTION OF LOCATING SIGNS SHALL BE GIVEN BY THE SJCUD INSPECTOR ON SITE. LANDSCAPING SHOULD BE CONSIDERED WHEN PLACING SIGN.

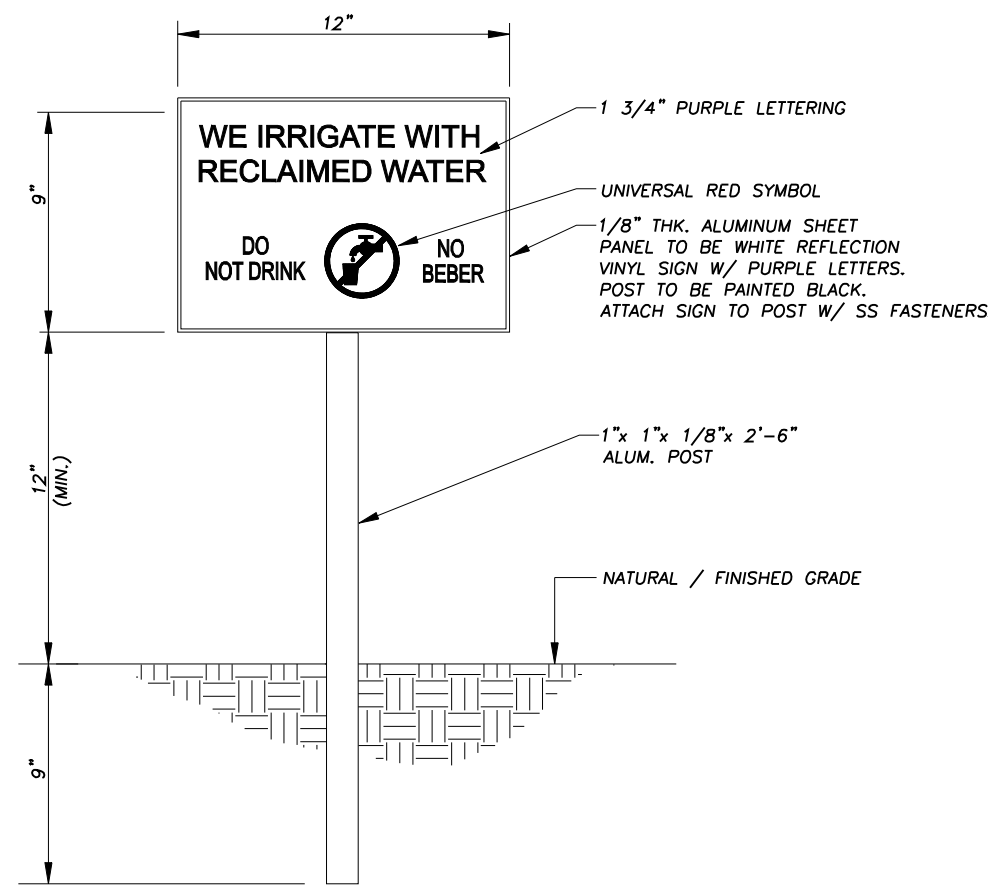

RECLAIMED WATER USE/WARNING SIGN - DIMINUTIVE

NOTE: EACH DEVELOPMENT, SUBDIVISION, OR COMMERCIAL ESTABLISHMENT, REGARDLESS OF THE NUMBER OF BUILDINGS, SHALL INSTALL DIMINUTIVE RECLAIMED WATER USE WARNING SIGNS ALONG SIDEWALKS, WALKING PATHS, AND ASSOCIATED AREAS WHERE STANDARD RECLAIMED WATER USE WARNING SIGNS ARE NOT PLAINLY VISIBLE DUE TO DISTANCE OR OTHER NON-VEGETATIVE OBSTRUCTION, OR NOT FEASIBLE. THE SIGNS SHALL MEET THE REQUIREMENTS OF SJCUD DETAILS AND SPECIFICATIONS. THE SIGNS SHALL BE A REQUIREMENT WHETHER SHOWN ON PLANS OR NOT. SIGNS SHALL BE CLEARLY VISIBLE TO RESIDENTS AND GUESTS ENTERING. PROXIMITY TO CURB AND LANDSCAPING SHOULD BE CONSIDERED WHEN PLACING SIGN. SIGN SHALL BE TALLER THAN LANDSCAPING AND NOT BE BLOCKED BY FUTURE GROWTH OF VEGETATION OR DAMAGED BY MAINTENANCE EQUIPMENT. PUBLIC ACCESS COMMON AREAS SHALL ALSO HAVE SIGNS (INCLUDES OFFSITE).

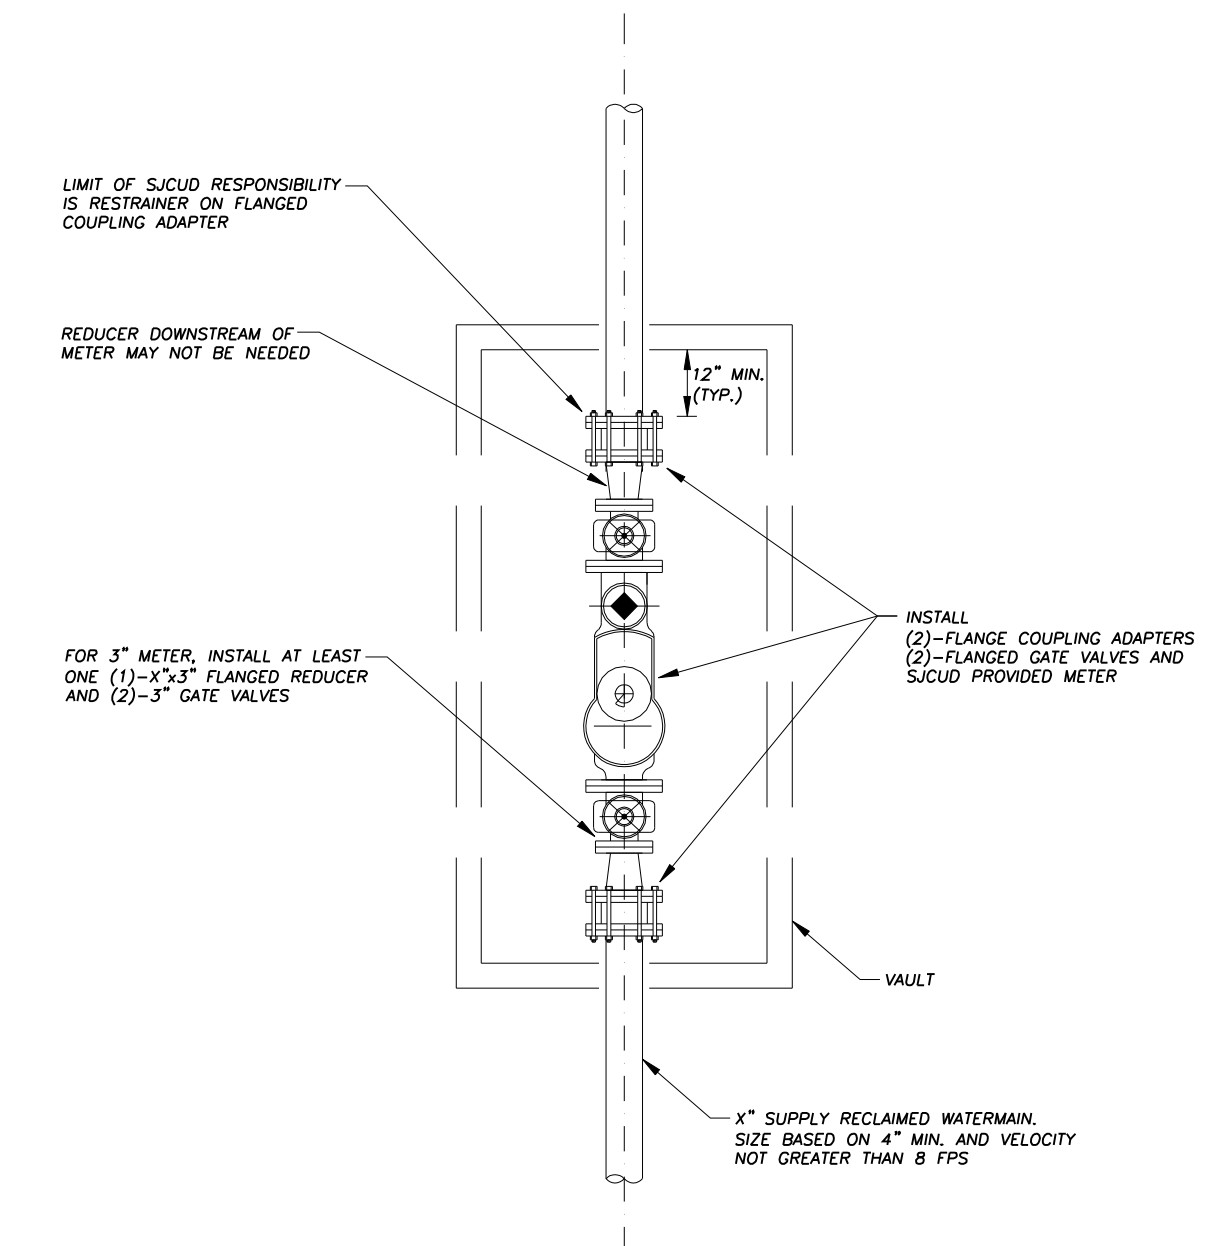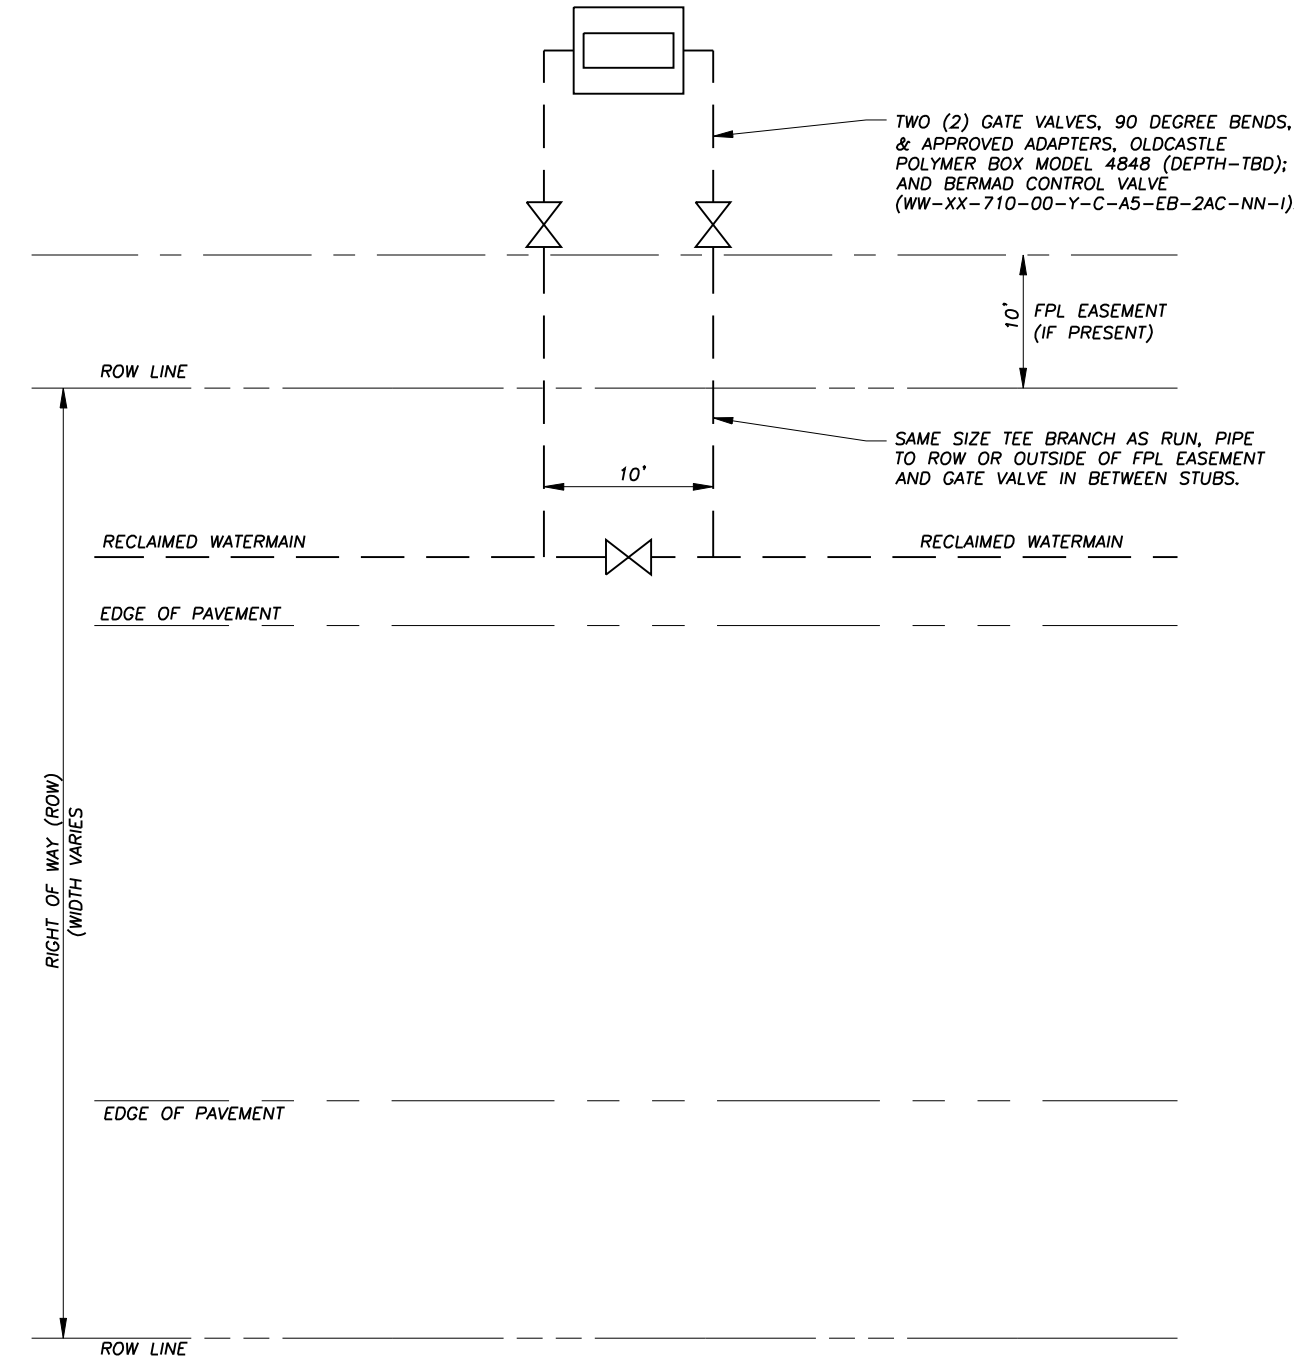

NOTES:
 1. METER SIZE SHALL BE THE SAME AS THE SUPPLY MAIN SIZE (EXCEPT 3" WHICH WILL HAVE A 4" MIN. SUPPLY MAIN).
 2. ALL MECHANICAL JOINTS ARE RESTRAINED.
 3. METER SHOULD SIT ON A CONCRETE BLOCK WITH OPEN CELLS FACING UP.
 4. VAULT SHALL BE MANUFACTURED BY ARMORCAST PRODUCTS AS LISTED IN THE APPROVED MATERIALS LIST OR SJCUD APPROVED EQUAL. ALL HARDWARE SHALL BE 316SS.

VAULT SIZE
 3" COMPOUND METER - 4'W x 6'L x 4'D
 4" COMPOUND METER - 4'W x 6'L x 4'D
 6" COMPOUND METER - 4'W x 6'L x 4'D
 8" COMPOUND METER - 4'W x 6'L x 4'D

REVISIONS		ST. JOHNS COUNTY UTILITY DEPARTMENT	RECLAIMED WATER USE/WARNING SIGN	SCALE: N.T.S.	PLATE: R-1
Date	Comments				
2020	REVISION 1	1205 STATE ROAD 16 ST. AUGUSTINE, FLORIDA 32084 Phone (904) 209-2700 • Fax (904) 209-2802			

REVISIONS		ST. JOHNS COUNTY UTILITY DEPARTMENT	RECLAIMED WATER USE/WARNING SIGN DIMINUTIVE	SCALE: N.T.S.	PLATE: R-2
Date	Comments				
2020	REVISION 1	1205 STATE ROAD 16 ST. AUGUSTINE, FLORIDA 32084 Phone (904) 209-2700 • Fax (904) 209-2802			

REVISIONS		ST. JOHNS COUNTY UTILITY DEPARTMENT	RECLAIMED WATER CONTROL VALVE INSTALLATION	SCALE: N.T.S.	PLATE: R-3
Date	Comments				
2020	REVISION 1	1205 STATE ROAD 16 ST. AUGUSTINE, FLORIDA 32084 Phone (904) 209-2700 • Fax (904) 209-2802			

REVISIONS		ST. JOHNS COUNTY UTILITY DEPARTMENT	STANDARD 3" - 8" RECLAIMED WATER METER INSTALLATION	SCALE: N.T.S.	PLATE: R-04
Date	Comments				
2020	REVISION 1	1205 STATE ROAD 16 ST. AUGUSTINE, FLORIDA 32084 Phone (904) 209-2700 • Fax (904) 209-2802			
5/22	REVISION 2				

NO.	BY	DATE	SYMBOL	REVISIONS
1.	SJCUD	2020		REVISION 1

DESIGNER:	DESIGN ENGINEER:
DRAWN BY:	FLORIDA REGISTRATION NO.
DATE:	
CHECKED BY:	
DATE:	

**ST. JOHNS COUNTY
UTILITY DEPARTMENT**
 1205 STATE ROAD 16
 ST. AUGUSTINE, FLORIDA 32084-8646
 Phone (904) 209-2700 • Fax (904) 209-2702

RECLAIMED WATER DETAILS

NO. SHEETS
SHEET NO. D-7
DRAWING NO. D-07.dwg